# 1492-AIFM6S-3 1492-RAIFM6S-3


Feed-Through 6-Channel Isolated with 3...4 Terminals/Channel



## Application Notes

- 1. Compatibility To ensure proper operation with the I/O module, do **not** exceed the voltage and current ratings of the AIFM.
- 2. Wiring Refer to the Label Section on page 174. For Field-Side Wiring Diagrams, refer to the Wiring System web site information on page 200.
- **3. Shield Terminals** Six field-side terminals are jumpered together on the AIFM and internally connected to the D-shell housing.
- **4. Dimensions** Refer to page 167.

### **Pinout**

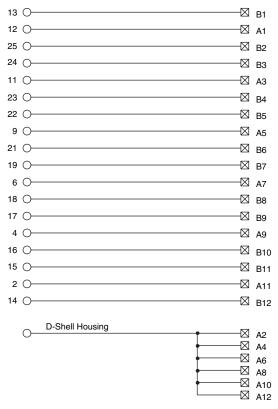

# 1492-AIFM8-3 1492-RAIFM8-3


Feed-Through 8-Channel Differential 16-Channel Single-Ended with 3 Terminals/Channel



# Application Notes

- 1. Compatibility To ensure proper operation with the I/O module, do **not** exceed the voltage and current ratings of the AIFM.
- 2. Wiring Refer to the Label Section on page 174. For Field-Side Wiring Diagrams, refer to the Wiring System web site information on page 200.
- 3. Extra Terminals Eight field-side terminals are jumpered together on the AIFM. For some I/O modules, the terminals are also internally connected to module common through the prewired cable. Refer to the AIFM and ACABLE pinouts.
- **4. Shield Terminals** Eight field-side terminals are jumpered together on the AIFM and internally connected to the D-shell housing.
- **5. Dimensions** Refer to page 167.

### **Pinout**

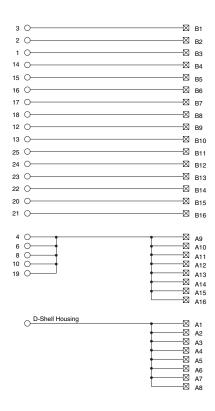

## 1492-AIFM6TC-3


Thermocouple 6-Channel with 3 Terminals/Channel



## Application Notes

- Compatibility To ensure proper operation with the I/O module, do not exceed the voltage and current ratings of the AIFM.
- 2. Wiring Refer to the Label Section on page 174. For Field-Side Wiring Diagrams, refer to the Wiring System web site information on page 200.
- **3. Shield Terminals** Six field-side terminals are jumpered together on the AIFM and internally connected to the D-shell housing.
- 4. Cold Junction Compensation This AIFM contains on-board cold junction compensation (CTC) through a thermistor (T) and isothermal bar mounted to the field-side terminals. Do **not** install the cold junction sensor (provided with the Catalog Number 1756-IT6I or 1756-IT6I2 thermocouple input module) on the removable terminal block of the pre-wired cable. This module is NOT compatible with other PLC systems (e.g. bulletin numbers 1746, 1771, etc.) that do not have external CJC capability.
- **5. Dimensions** Refer to page 167.

#### **Pinout**

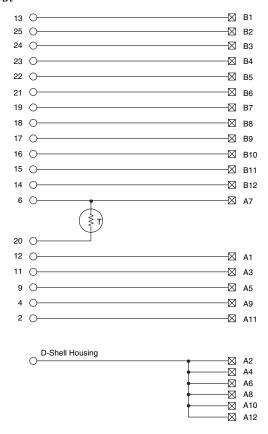

For updated page numbers refer to:
Publication 1492-TD008C-EN-P - September 2005