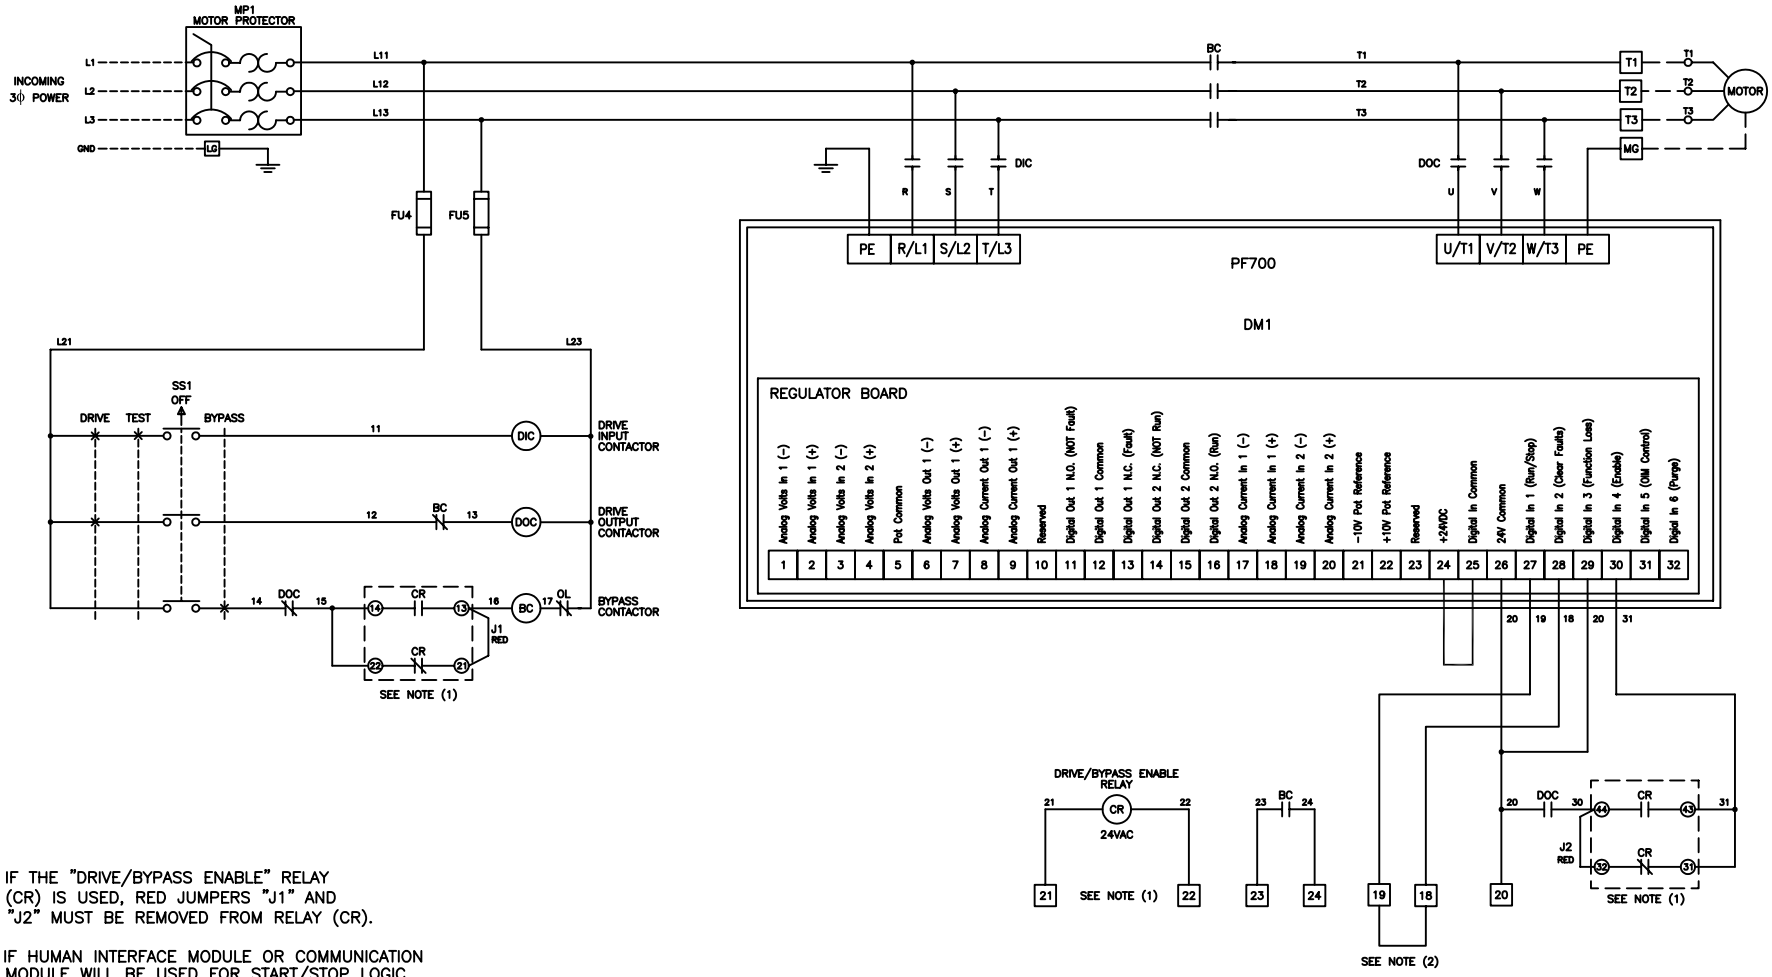

(1) IF THE "DRIVE/BYPASS ENABLE" RELAY (CR) IS USED, RED JUMPERS "J1" AND "J2" MUST BE REMOVED FROM RELAY (CR).

(2) IF HUMAN INTERFACE MODULE OR COMMUNICATION MODULE WILL BE USED FOR START/STOP LOGIC, JUMPER BETWEEN TERMINALS 18 AND 19 MUST BE MOVED TO 19 AND 20.

DATE	BY	APPROVAL
		DESIGN REVIEW
		FOR MANUFACTURING
		AS SHIPPED
		AS COMMISSIONED

REV.	DATE	BY	ECN/CR. NO.
A	6/19/07	REH	

Rockwell Automation

THIS DRAWING IS THE PROPERTY OF ROCKWELL AUTOMATION, INC. OR ITS SUBSIDIARIES AND MAY NOT BE COPIED, USED OR DISCLOSED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING BY ROCKWELL AUTOMATION, INC.

TITLE
SCHEMATIC DRAWING, PF700, STYLE C
60HP @ 460VAC

DR. BY REH/ACI DATE 6/19/07	CHK. BY AWR/ACI DATE 6/19/07	ENG. DATE	DWG. NO. 98D01245 –	NEXT SH. 1	SH. NO. 1