



230 V AC, hysteresis 1 % ... 10 % of measuring range

- 1-channel
- Input EEx ia IIC
- 2 switching points operate on 2 output relays
- High/low alarm can be selected for each switching point
- Mode of operation of the relay adjustable separately
- Lead breakage monitoring (can be deactivated)
- 3 1/2-digit LC-display for switching points and actual value
- All operating and indicator elements on the front side


Discontinued type

Function

Trip amplifiers are installed with the Pt100 or Ni100 for temperature measurements.

High alarm indicates that the alarm is activated when a limit is exceeded and is reset when another limit is not met. The hysteresis, which is the difference between these limits, is adjustable. Low alarm means that the alarm is tripped when a limit is not reached.

The input is safely isolated from the outputs and power supply per DIN EN 50020.

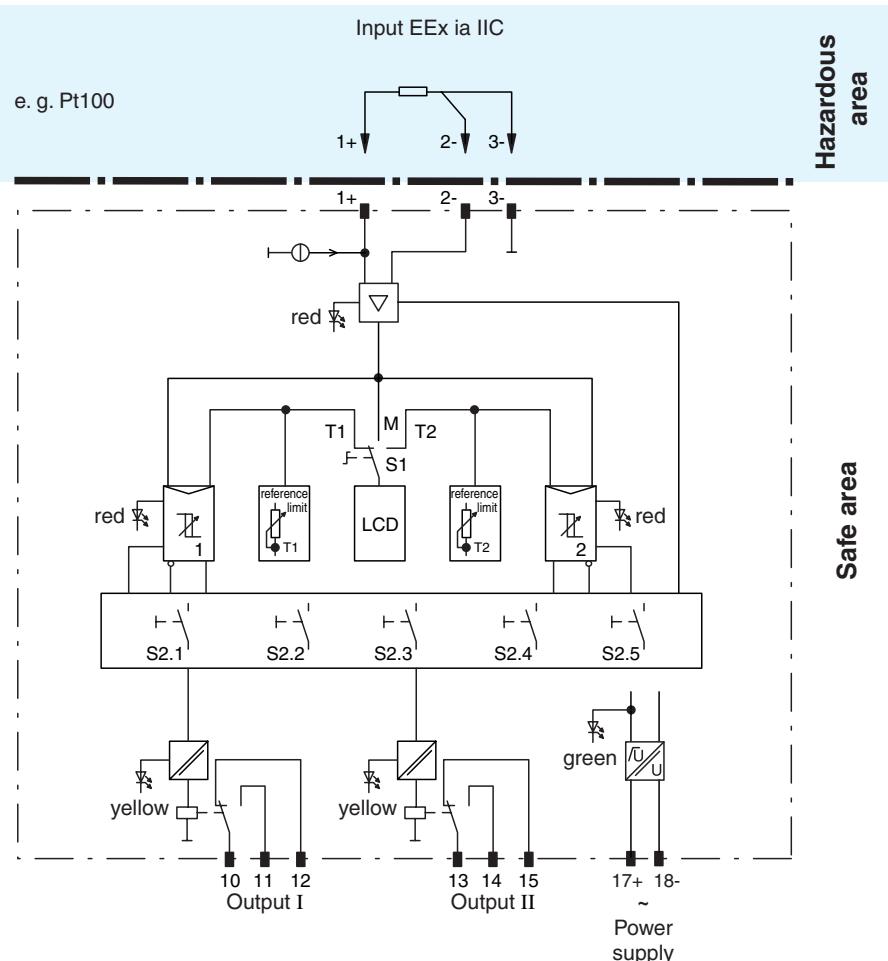

Composition

Front View

Housing type E
(see system description)

Switch S1

Display selection switch

LED yellow:

Switching status output I

LED green:

Power supply

LED red:

Fault signal

LED yellow:

Switching status output II

LED red:

Alarm II

Potentiometer T1

Trip value channel I

Potentiometer T2

Trip value channel II

Terminal blue

LC-display


LED red:
Alarm II

Switch S2
Function setting

Potentiometer 2
Hysteresis channel II

Potentiometer 1
Hysteresis channel I

Terminal green

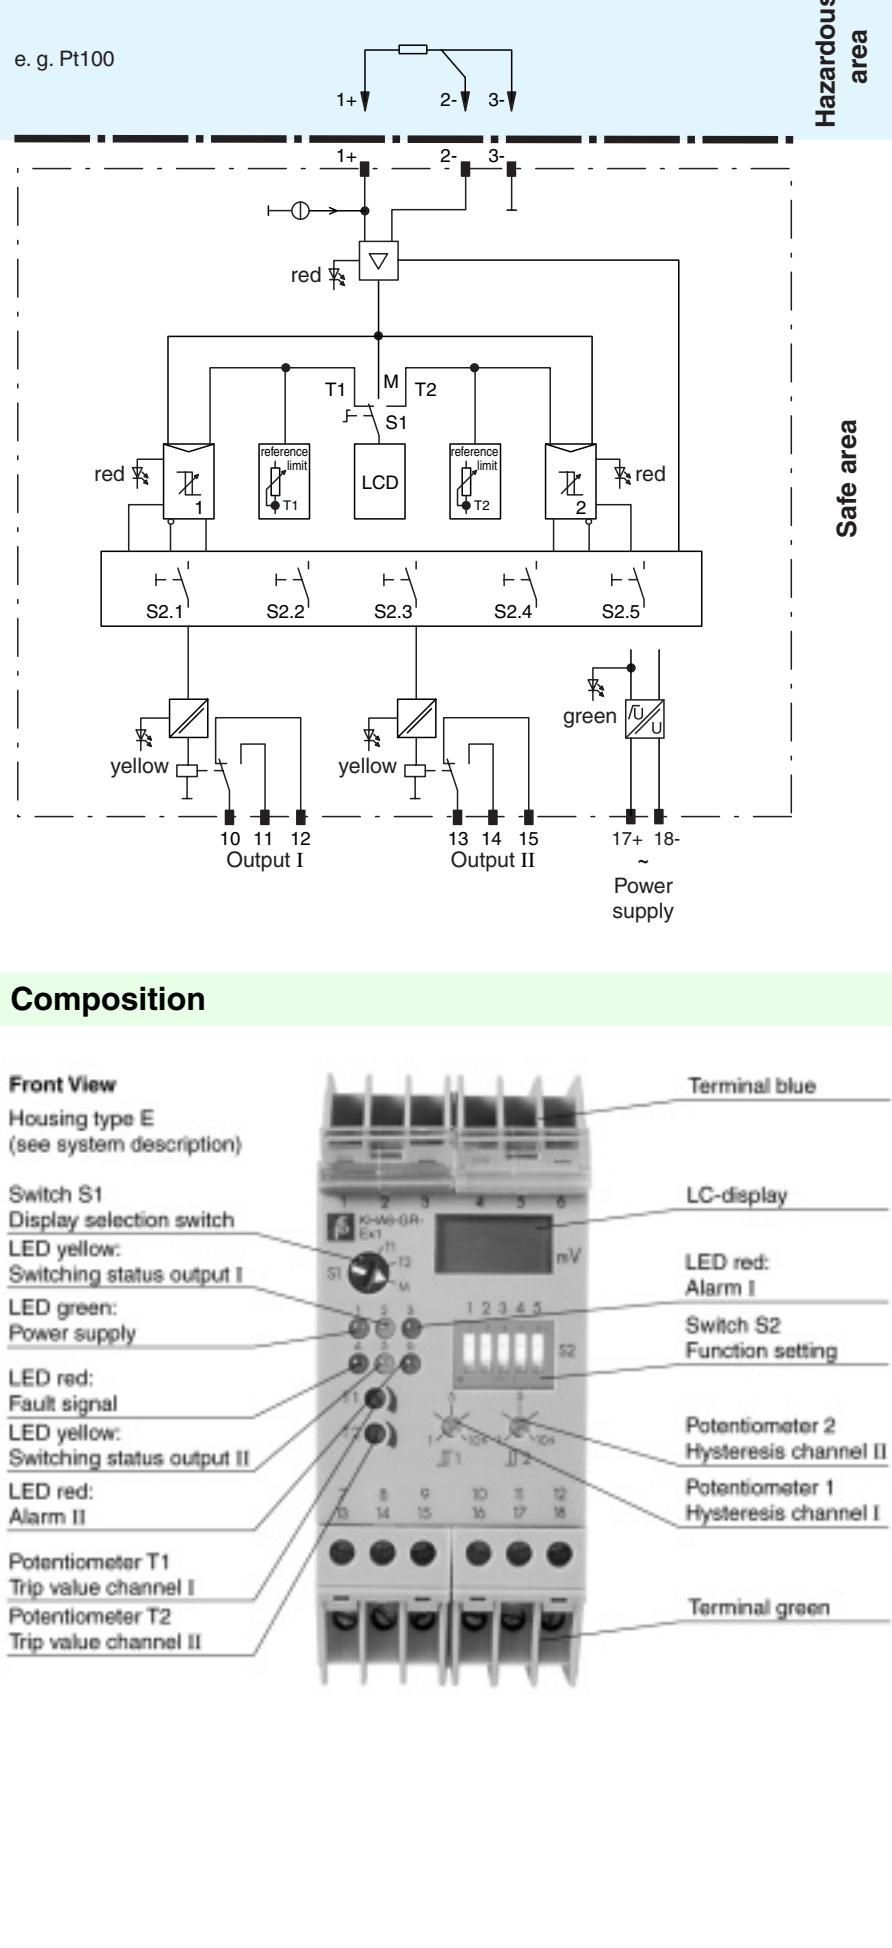

Supply	
Connection	terminals 17, 18
Rated voltage	85 ... 253 V C
Power consumption	approx. 2 W
Input	
Connection	terminals 1+, 2+, 3-
Measurement range	Pt100: 10 ... 390 Ω
Measuring current	approx. 2 mA
Output	
Output I	limit value 1: terminals 10, 11, 12
Output II	limit value 2: terminals 13, 14, 15
Contact loading	253 V AC, 2 A, cos φ > 0.6
Mechanical life	2 x 10 ⁷ switching cycles
Transfer characteristics	
Deviation	LC-display, $\pm 0.5\%$ of measuring value + 1 digit
Temperature	<u>switching point</u> : 0.015 % / K of measuring range <u>display</u> : 0.01 % / K of measuring range
Influence of supply voltage	not measurable
Repeat accuracy	0.2 %
Input delay	250 ms (rise time and energising delay of relay)
Electrical isolation	
Input/Output	safe electrical isolation acc. to EN 50020, voltage peak value 375 V
Input/Power supply	safe electrical isolation acc. to EN 50020, voltage peak value 375 V
Output/Power supply	safe isolation acc. to DIN VDE 0106, rated insulation voltage 253 V _{eff}
Output/Output	safe isolation acc. to DIN VDE 0106, rated insulation voltage 253 V _{eff}
Standard conformity	
Coordination of insulation	acc. to DIN EN 50178
Electrical isolation	acc. to DIN EN 50178
Electromagnetic compatibility	acc. to EN 50081-2 / EN 50082-2
Climatic conditions	acc. to DIN IEC 721
Directive conformity	
Electromagnetic compatibility	standards
Directive 89/336/EG	on request
Ambient conditions	
Ambient temperature	-20 ... 60 °C (253 ... 333 K)
Mechanical specifications	
Protection degree	IP20
Mass	approx. 250 g
Data for application in conjunction with hazardous areas	
EC-Type Examination Certificate	PTB No. Ex-93.C.2071 ; for additional certificates refer to the approval list
Voltage U ₀	22 V DC
Current I ₀	9.8 mA
Power P ₀	38 mW
Type of protection [EEx ia]	
Explosion group	IIB IIC
External capacitance	0.425 μ F 0.068 μ F
External inductance	25 mH 5 mH
Type of protection [EEx ib]	
Explosion group	IIB IIC
External capacitance	0.766 μ F 0.126 μ F
External inductance	1000 mH 330 mH
Supply	
Safety maximum voltage U _m	253 V AC
Electrical isolation	
Input/Output	safe electrical isolation acc. to EN 50020, voltage peak value 375 V
Input/Power supply	safe electrical isolation acc. to EN 50020, voltage peak value 375 V
Safety parameter	
CSA control drawing	LR 36087-8

Notes

Function description

The trip amplifier sends a measurement current of about 2 mA from terminal 1 to terminal 3 through the resistance thermometer. The input is designed for 3-wire mode in which terminal 2 serves as lead compensation. The LCD displays the resistance of the Pt100 directly in Ohms. By means of the Pt100-value table you can conclude to the corresponding measurement temperature.

A comparator checks the measurement values against the two selected reference limits. The hysteresis, the operating mode and the alarm type (high or low alarm) may be selected for each switch point. The output relays transfer the potential isolated switching status to output terminals 10, 11, 12 and 13, 14, 15. Lead breakage in the input circuit causes the output relays to be deactivated.

LC-display

Reference or actual values are displayed in Ohm. From the Pt100- or Ni100-value table (see last page) the corresponding measurement temperature can be concluded.

LC-display selector switch

With switch S1 it is possible to select, which value (actual or reference value) is indicated on the LC-display.

S1 in Pos. T1: Switch point 1 (reference value or limit value 1)

S1 in Pos. T2: Switch point 2 (reference value or limit value 2)

S1 in Pos. M: Actual value

Potentiometer T1, T2

By means of the potentiometers T1 or T2 the switch points or limit values are set.

T1: Adjustment of switch point 1 (reference value or limit value 1)

T2: Adjustment of switch point 2 (reference value or limit value 2)

Potentiometer $\text{J}1$ and $\text{J}2$

The potentiometers $\text{J}1$ and $\text{J}2$ serve for the hysteresis adjustment of the individual switch points in a range of 1 % ... 10 % (KFD2-GR-Ex1) or 0.1 % ... 1 % (KFD2-GR-Ex1.RH) related to the measurement value.

$\text{J}1$ hysteresis switch point 1 (reference value or limit value 1)

$\text{J}2$ hysteresis switch point 2 (reference value or limit value 2)

DIP switch S2

Switch	Position	Function
S2.1	OPEN	High alarm output I
	-	Low alarm output I
S2.2	OPEN	Relays closed on alarm state
	-	Relays open in alarm state
S2.3	OPEN	Lead breakage monitoring off
	-	Lead breakage monitoring on
S2.4	OPEN	High alarm output II
	-	Low alarm output II
S2.5	OPEN	Relays closed on alarm state
	-	Relays open in alarm state

1. Basic values in Ohm from 5 degrees to 5 degrees for temperature sensors with heating resistor material platinum (Pt).

°C	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	-50
-200	18.53	16.43	14.36	12.35	10.41	-	-	-	-	-	-
-100	60.20	58.17	56.13	54.09	52.04	49.99	47.93	45.87	43.80	41.73	39.65
0	100.00	98.04	96.07	94.10	92.13	90.15	88.17	86.19	84.21	82.23	80.25
°C	-55	-60	-65	-70	-75	-80	-85	-90	-95	-100	W/grd ¹⁾
-200	-	-	-	-	-	-	-	-	-	-	-
-100	37.57	35.48	33.38	31.28	29.17	27.05	24.92	22.78	20.65	18.53	0.42
0	78.27	76.28	74.29	72.29	70.29	68.28	66.27	64.25	62.23	60.20	0.40
°C	0	5	10	15	20	25	30	35	40	45	50
0	100.00	101.95	103.90	105.85	107.79	109.73	111.67	113.61	115.54	117.47	119.40
100	138.50	140.39	142.28	144.18	146.06	147.94	149.82	151.70	153.57	155.45	157.32
200	175.84	177.68	179.51	181.34	183.17	185.00	186.82	188.64	190.46	192.27	194.08
300	212.03	213.81	215.58	217.36	219.13	220.90	222.66	224.42	226.18	227.94	229.69
400	247.06	248.78	250.50	252.21	253.93	255.64	257.34	259.05	260.75	262.45	264.14
500	280.93	282.60	284.26	285.91	287.57	289.22	290.87	292.51	294.16	295.80	297.43
600	313.65	315.25	316.86	318.46	320.05	321.65	323.24	324.83	326.41	327.99	329.57
700	345.21	346.76	348.30	349.84	351.38	352.92	354.45	355.98	357.51	359.03	360.55
800	375.61	377.10	378.59	380.07	381.55	383.03	384.50	385.98	387.45	388.91	390.38
°C	55	60	65	70	75	80	85	90	95	100	W/grd ¹⁾
0	121.32	123.24	125.16	127.07	128.98	130.89	132.80	134.70	136.60	138.50	0.38
100	159.18	161.04	162.90	164.76	166.62	168.47	170.32	172.16	174.00	175.84	0.37
200	195.89	197.70	199.50	201.30	203.09	204.88	206.68	208.46	210.25	212.03	0.36
300	231.44	233.19	234.93	236.67	238.41	240.15	241.88	243.61	245.34	247.06	0.35
400	265.83	267.52	269.21	270.89	272.57	274.25	275.92	277.60	279.27	280.93	0.34
500	299.07	300.70	302.33	303.95	305.58	307.20	308.81	310.43	312.04	313.65	0.33
600	331.15	332.72	334.29	335.86	337.43	338.99	340.55	342.10	343.66	345.21	0.32
700	362.07	363.59	365.10	366.61	368.12	369.62	371.12	372.62	374.12	375.61	0.30
800	-	-	-	-	-	-	-	-	-	-	0.29

2. Basic values in Ohm from 5 degrees to 5 degrees for temperature sensors with heating resistor material Nickel (Ni)

°C	0	-5	-10	-15	-20	-25	-30	-35	-40	-45	-50
0	100.0	97.3	94.6	91.9	89.3	86.7	84.1	81.6	79.1	76.6	74.2
°C	-55	-60	-65	-70	-75	-80	-85	-90	-95	-100	W/grd ¹⁾
0	71.8	69.5	-	-	-	-	-	-	-	-	0.51
°C	0	5	10	15	20	25	30	35	40	45	50
0	100.0	102.8	105.6	108.4	111.3	114.2	117.1	120.0	123.0	126.0	129.1
100	161.7	165.2	168.7	172.3	175.9	179.6	183.3	187.1	190.9	194.8	198.7
°C	55	60	65	70	75	80	85	90	95	100	W/grd ¹⁾
0	132.2	135.3	138.5	141.7	144.9	148.2	151.5	154.9	158.3	161.7	0.62
100	202.7	206.7	210.8	214.9	219.0	223.1	-	-	-	-	0.77

¹⁾ Mean value, of the 100 degree-ranges