




### Model Number

NJ15S+U1+N

### Features

- 15 mm flush
- Usable up to SIL 3 acc. to IEC 61508

### Connection



### Accessories

#### MHW 01

Modular mounting bracket


#### MH 04-2681F

Mounting aid for VariKont, +U1+ and +U9\*

#### MH 04-2057B

Mounting aid for VariKont and +U1+

### Dimensions

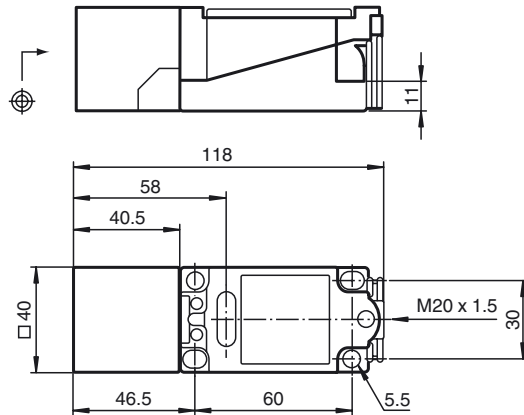

### Technical Data

#### General specifications

|                            |       |                 |
|----------------------------|-------|-----------------|
| Switching element function |       | NAMUR, NC       |
| Rated operating distance   | $s_n$ | 15 mm           |
| Installation               |       | flush           |
| Output polarity            |       | Safety Function |
| Assured operating distance | $s_a$ | 0 ... 12.15 mm  |
| Reduction factor $r_{AI}$  |       | 0.4             |
| Reduction factor $r_{Cu}$  |       | 0.3             |
| Reduction factor $r_{304}$ |       | 0.85            |

#### Nominal ratings

|                              |       |                                      |
|------------------------------|-------|--------------------------------------|
| Nominal voltage              | $U_o$ | 8.2 V ( $R_i$ approx. 1 k $\Omega$ ) |
| Switching frequency          | $f$   | 0 ... 150 Hz                         |
| Current consumption          |       |                                      |
| Measuring plate not detected |       | $\geq 3$ mA                          |
| Measuring plate detected     |       | $\leq 1$ mA                          |

#### Ambient conditions

|                     |  |                                 |
|---------------------|--|---------------------------------|
| Ambient temperature |  | -40 ... 100 °C (-40 ... 212 °F) |
|---------------------|--|---------------------------------|

#### Mechanical specifications

|                    |  |                           |
|--------------------|--|---------------------------|
| Connection type    |  | screw terminals           |
| Core cross-section |  | up to 2.5 mm <sup>2</sup> |
| Housing material   |  | PBT                       |
| Sensing face       |  | PBT                       |
| Protection degree  |  | IP68                      |

#### General information

|                           |  |                         |
|---------------------------|--|-------------------------|
| Use in the hazardous area |  | see instruction manuals |
| Category                  |  | 1G; 2G; 1D              |

#### Compliance with standards and directives

|                     |  |   |
|---------------------|--|---|
| Standard conformity |  |   |
| NAMUR               |  | EN 60947-5-6:2000<br>IEC 60947-5-6:1999 |
| Standards           |  | EN 60947-5-2:2007<br>IEC 60947-5-2:2007 |

#### Approvals and certificates

|              |  |  |
|--------------|--|--|
| UL approval  |  | cULus Listed, General Purpose  |
| CSA approval |  | cCSAus Listed, General Purpose   |
| CCC approval |  | Products with a maximum operating voltage of $\leq 36$ V do not bear a CCC marking because they do not require approval. |

**ATEX 1G**

Instruction

Device category 1G

Directive conformity  
Standard conformity

CE marking

Ex-identification

EC-Type Examination Certificate

Appropriate type

Effective internal capacitance  $C_i$ Effective internal inductance  $L_i$ 

General

Highest permissible ambient temperature

Installation, Commissioning

Maintenance

**Specific conditions**

Protection from mechanical danger

Electrostatic charging


**Manual electrical apparatus for hazardous areas**for use in hazardous areas with gas, vapour and mist  
94/9/EG

EN 60079-0:2009, EN 60079-11:2007, EN 60079-26:2007

Ignition protection "Intrinsic safety"

Use is restricted to the following stated conditions


 0102

 II 1G Ex ia IIC T6 Ga

PTB 00 ATEX 2049 X

NJ15S+U.-N..

 $\leq 180$  nF ; a cable length of 10 m is considered. $\leq 150$   $\mu$ H ; a cable length of 10 m is considered.

The apparatus has to be operated according to the appropriate data in the data sheet and in this instruction manual. The EC-Type Examination Certificate has to be observed. The special conditions must be adhered to!

The temperature ranges, according to temperature class, are given in the EC-Type Examination Certificate. Note: Use the temperature table for category 1 !!! The 20 % reduction in accordance with EN 1127-1:2007 has already been accounted for in the temperature table for category 1.

Laws and/or regulations and standards governing the use or intended usage goal must be observed.

The intrinsic safety is only assured in connection with an appropriate related apparatus and according to the proof of intrinsic safety.

The associated apparatus must satisfy the requirements of category ia.

Due to the possible danger of ignition, which can arise due to faults and/or transient currents in the equipotential bonding system, galvanic isolation of the power supply and signal circuit is preferable. Associated apparatus without electrical isolation must only be used if the appropriate requirements of IEC 60079-14 are met.

No changes can be made to apparatus, which are operated in hazardous areas. Repairs to these apparatus are not possible.

When used in the temperature range below  $-20$  °C the sensor should be protected from knocks by the provision of an additional housing.

When used in group IIC non-permissible electrostatic charges should be avoided on the plastic housing parts.

**ATEX 2G**

Instruction

**Device category 2G**

Directive conformity

Standard conformity

CE marking

Ex-identification

EC-Type Examination Certificate

Appropriate type

Effective internal capacitance  $C_i$ Effective internal inductance  $L_i$ 

General

Highest permissible ambient temperature

Installation, Commissioning

Maintenance

**Specific conditions**

Protection from mechanical danger

**Manual electrical apparatus for hazardous areas**

for use in hazardous areas with gas, vapour and mist

94/9/EG

EN 60079-0:2009, EN 60079-11:2007

Ignition protection "Intrinsic safety"

Use is restricted to the following stated conditions

C  $\text{E}$  0102 $\text{Ex}$  II 1G Ex ia IIC T6 Ga

PTB 00 ATEX 2049 X

NJ15S+U.-N..

 $\leq 180$  nF ; a cable length of 10 m is considered. $\leq 150$   $\mu$ H ; a cable length of 10 m is considered.

The apparatus has to be operated according to the appropriate data in the data sheet and in this instruction manual. The EC-Type Examination Certificate has to be observed. The special conditions must be adhered to!

The temperature ranges, according to temperature class, are given in the EC-Type Examination Certificate.

Laws and/or regulations and standards governing the use or intended usage goal must be observed. The intrinsic safety is only assured in connection with an appropriate related apparatus and according to the proof of intrinsic safety.

No changes can be made to apparatus, which are operated in hazardous areas. Repairs to these apparatus are not possible.

When used in the temperature range below  $-20$  °C the sensor should be protected from knocks by the provision of an additional housing.

**ATEX 1D**

Instruction

**Device category 1D**

Directive conformity

Standard conformity

CE marking

Ex-identification

EC-Type Examination Certificate

Appropriate type

Effective internal capacitance  $C_i$ Effective internal inductance  $L_i$ 

General

Maximum housing surface temperature

Installation, Commissioning

Maintenance

**Specific conditions**

Electrostatic charging

**Manual electrical apparatus for hazardous areas**


for use in hazardous areas with combustible dust

94/9/EG

IEC 61241-11:2002: draft; prEN61241-0:2002

type of protection intrinsic safety "ID"

Use is restricted to the following stated conditions

**CE** 0102 II 1D Ex iaD 20 T 108 °C (226.4 °F)

ZELM 03 ATEX 0128 X

NJ15S+U.-N..

≤ 180 nF ; a cable length of 10 m is considered.

≤ 150 μH ; a cable length of 10 m is considered.

The apparatus has to be operated according to the appropriate data in the data sheet and in this instruction manual.

The EC-Type Examination Certificate has to be observed.

The special conditions must be adhered to!

The maximum surface temperature of the housing is given in the EC-Type Examination Certificate.

Laws and/or regulations and standards governing the use or intended usage goal must be observed.

The intrinsic safety is only assured in connection with an appropriate related apparatus and according to the proof of intrinsic safety.

The associated apparatus must satisfy at least the requirements of category ia IIB or iaD. Because of the possibility of the danger of ignition, which can arise due to faults and/or transient currents in the equipotential bonding system, galvanic isolation in the power supply and signal circuits is preferable. Associated apparatus without electrical isolation must only be used if the appropriate requirements of IEC 60079-14 are met. The intrinsically safe circuit has to be protected against influences due to lightning.

When used in the isolating wall between Zone 20 and Zone 21 or Zone 21 und Zone 22 the sensor must not be exposed to any mechanical danger and must be sealed in such a way, that the protective function of the isolating wall is not impaired. The applicable directives and standards must be observed.

No changes can be made to apparatus, which are operated in hazardous areas. Repairs to these apparatus are not possible.

Electrostatic charging due to the flow of media during operation must be excluded. This can be achieved by limiting the surface area of the plastic housing exposed to the electrostatic charging to less than 100 cm<sup>2</sup>.